



GREEN BUILDINGS

FACILITY MANAGEMENT L.L.C

Office No. 2101, 21st Floor C88 Tower A, DNATA Bldg., Abu Dhabi, UAE

Contact Us: +971 2 550 6361 hello@gbfm.ae <https://gbfm.ae/>

2025

Water Tank Cleaning & Disinfection Work Completion Report

Client	Shining Star School
Project	Shining Star School
Location	Musaffah, Abu Dhabi
Date of Cleaning	25 th & 26 th of December 2025



**Shining Star
International School**

Prepared by: Elaiza

Date Prepared: 30th of December 2025

Assigned Team Leader: Ali Raza



مجلس أبوظبي
للجودة والمطابقة
Abu Dhabi Quality &
Conformity Council



ABU DHABI PUBLIC
HEALTH CENTRE | مركز أبوظبي
للصحة العامة





WORK COMPLETION CERTIFICATE

Cleaning & Disinfection
has been Completed Successfully

Client

Shining Star School

Project Location

Musaffah, Abu Dhabi

Frequency

Every **6(six) Months**

Date Of Cleaning:

25th & 26th of December 2025

Suggested Next Cleaning Date:

25th & 26th of June 2026

Please see the attached pictorial Report.

The Procedure Employed in This Cleaning and Disinfection Complies with **RSB Guidelines and Safety Guidelines** as well as **BS6700 & Green Buildings Facility Management LLC Method Statements**.

Contact Us!



Operations Manager

Mr. Anil Kumar

Mobile: **+971 55 982 4750** | email: **anil@gbfm.ae**





INTRODUCTION

Green Buildings Facility Management LLC is one of the leading companies that specializes in Air Duct cleaning, Water Tank cleaning, and Pest Control in Abu Dhabi, United Arab Emirates, both for residential and commercial properties. With the use of top-of-the-line equipment, which includes powerful rotary brushes, high-powered air pressure machines, and powerful vacuums, you can rest assured that you and your family will breathe cleaner air and use cleaner water. Our well-trained and experienced technicians will make sure that you are completely satisfied before they leave.

Table of Contents

- Introduction
- Safety and PPE
- Equipment Used
- Cleaning Agents used
- Why Green Building uses Aqua Kleene
- The Process of Cleaning
- WHO standards followed by UAE

CLEANING AGENTS USED

Green Buildings uses Aqua Kleene, a cleaning agent specifically formulated for water tank cleaning. Aqua Kleene is a Biocide disinfectant cleaner for water tanks and it is bio-degradable. The detergent is manufactured in the United Arab Emirates.

OBSERVATIONS

All tanks were in good condition. We did not find any leakage in the tanks.

Water was at the minimum level.

The floater was cleaned and disinfected

There was no water interruption in the premises during cleaning

SAFETY & PPE

Larger water tanks and reservoirs are confined spaces and many of the areas they are located can also be enclosed. To minimize the risk, our teams carry and use gas detectors to ensure that a safe environment is maintained. Forced ventilation is used where there may be a question regarding air quality in the water tank or surrounding area. Our team also has all required PPE such as gloves, helmets, safety harnesses, and boots. A First Aid kit is also provided for the team for minor abrasions or small cuts that may occur on the site. In case of working in a confined space, we shall seek permission from the EHS Office in the municipality. We shall arrange the EHS required as per the EHS Regulatory Instrument – Code of Practice No. 27.0 – Confined Spaces. PPE provided for the employees shall be under the EHS Regulatory Instrument – Code of Practice No. CoP 2.0

- Helmets** protect the head against injury.
- Goggles** are used when chemicals are applied and cleaning is in the process so that cleaning agents do not splash into the eye.
- Safety Harnesses** are worn when employees work at heights.
- Boots** are used for the protection of feet from debris while inside the tank.
- Gloves** will protect the hands when chemicals are being applied and walls are scrubbed.
- A First Aid kit** is used for treating minor abrasions and cuts.





EQUIPMENT USED

Green Buildings uses modern, safe, and inspected equipment to clean water tanks. Our equipment includes such things as Submersible cameras, pumps (petrol and electrical), high-pressure cleaners, etc.

- ❑ **Electric pumps:** These are one to one and a half (1-1.5) horsepower electric pumps that are normally used in Polyethylene and GRP tanks. The discharge rate for this pump is 75 US gallons per minute. The electric cable is water-tight with extensions made using a 3M water-resistant insulation tape.
- ❑ **High-Pressure Machine:** The interior surface of the water tanks is cleaned using high-pressure pumps. We have various high-pressure pumps for tanks depending on their size. The pumps rinse the sediment and cleaning agent from surfaces. The pressure of the pump ranges from 2.5 bar to 12.0 bar.
- ❑ **Ventilation fans** to circulate and replenish fresh air into the water tank.
- ❑ **Industrial Sockets** is used to eliminate electrical risk.



LABORATORY WATER SAMPLES

The periodic sampling and testing of water sources for the presence of **Legionella** bacteria is a valuable means of demonstrating to the regulator, clients, colleagues, and other important stakeholders that adequate control over a water system is being maintained and that levels of Legionella bacteria are kept within safe limits.

Many contract testing companies specialize in **Legionella** management and testing of water. Legionella is typically isolated from **water by filtration followed by heat or acid treatment**, then plated onto non-selective BCYE agar, and then with a selective GVPC (cycloheximide) agar. Microbiological analysis is the **most effective way to detect fecal contamination in water**. Obtrusively, feces of humans, animals, birds, and livestock enter the water and make it unfit for consumption. Microbiological analysis of water is an important aspect of water testing.

Microbiological water analysis is a **method of analyzing water to estimate the number of bacteria present and to allow for the recovery of microorganisms to identify them**. The method of examination is the plate count. ... When it is desirable to obtain a specific bacterial species, a selective medium can be used.





ACTIVE INGREDIENTS OF AQUAKLEENE AC DUCT CLEANER CATIONIC & NONIONIC SURFACTANT

What are cationics used for?

Cationic detergents are more strongly absorbed on fabrics that are anionic or nonionic surfactants. They are used as wetting agents, fabric softeners, bacteriostats, and emulsifiers. Examples of cationic detergents are quaternary ammonium compounds, benzalkonium chloride, and cetyltrimethylammonium bromide.

Which is an example of cationic surfactants?

A common example of cationic surfactant is alkyl ammonium chlorides.

What is the purpose of surfactants?

The main functions of surfactant are as follows: (1) lowering surface tension at the air-liquid interface and thus preventing alveolar collapse at end-expiration, (2) interacting with and subsequently killing pathogens or preventing their dissemination, and (3) modulating immune responses.

What is alkyl dimethyl benzyl ammonium chloride used for?

N-alkyl C12-C14 dimethyl ethyl benzyl ammonium chloride is added to products to function as a cleaning agent, or as antimicrobial agents in disinfecting cleaning products.

What is ammonium chloride used for cleaning?

Quaternary ammonium chloride (quat) is an active ingredient in disinfectants that are used widely throughout the cleaning industry. These disinfectants are popular because of their effectiveness against germs, bacteria, and viruses; their relatively low toxicity at proper dilution; low odors; and long shelf life.


What are nonionic surfactants?

Nonionic(no-charge)

Nonionic surfactants contain no charge. They are commonly found in laundry and dishwasher detergents. They are the second most widely used surfactants after anionic. These molecules have no charge and so they are less likely to form a 'soap scum' in hard water.

Disposal consideration:

WASTE CODE No. accordance to AVV: 20 01 29 Detergents

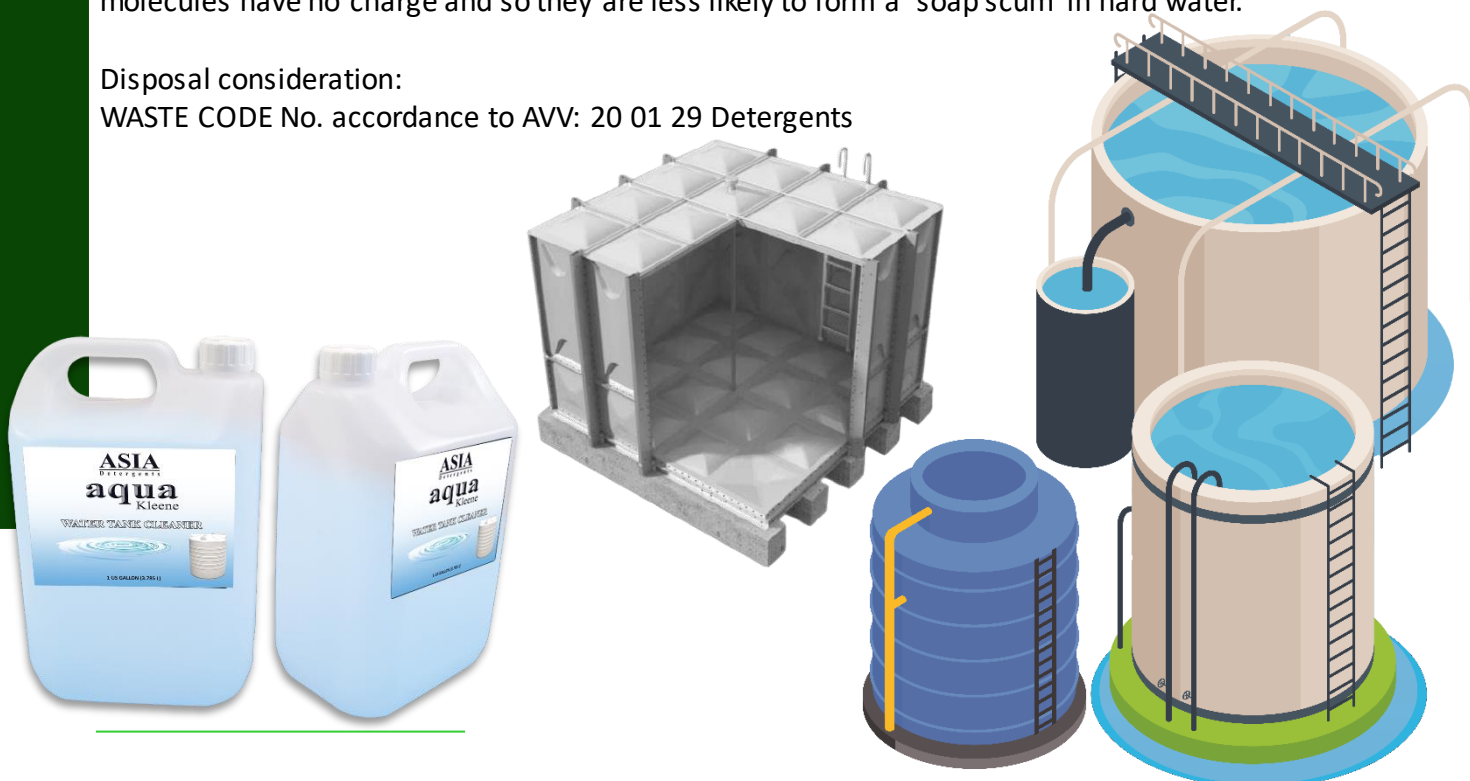



شهادة تسجيل منشآت تجارية متخصصة في تنظيف خزانات مياه الشرب
Certificate of registration for the establishments specialized in drinking water tanks cleaning

Trade License No.	202302636713	رقم الرخصة التجارية
Est. Trade Name	جرين بيلديغس لإدارة المنشآت ذ.م.م	إسم المنشأة التجارية
Registration Certificate Issuance Date	2025-09-23	تاريخ إصدار شهادة التسجيل
Registration Certificate Expiry Date	2027-09-22	تاريخ إنتهاء شهادة التسجيل
Est. Address	أبوظبي, الدانة, شرق 11, 0 : ~, مبنى, كورنينا هولدنغ ريستركتد ليمتد	عنوان المنشأة التجارية
Est. Details		بيانات المنشأة
Email / البريد الالكتروني	رقم الجوال / البديل	رقم الجوال / البديل
operations@gbcleaning.net	+971505502642	0501304365
		الإمين خان محمد خان

Terms and Conditions:

- The entity should comply with laws, regulations & codes as follows:
 - Law No. (2) of 2012 concerning the preservation of the general appearance, health & public calmness in Abu Dhabi, as well as its amendments & its executive regulations.
 - Administrative Decree No. (26) for the year 2018 concerning to public health and safety of drinking water tanks in the Emirate of Abu Dhabi.
 - Abu Dhabi guideline health control of building & public facilities.
 - Code of Practice for Inspection & cleaning of customer Water storage Tanks.
- Ensure that all the workers are registered and have obtained the required conformity certificate from Abu Dhabi quality & conformity Council as well as medical fitness certificate from Department of health.
- Follow all the technical procedures to prevent pollution & comply with the approved emergency response plan in case it occurs.
- Maintain the required operating registers in addition to all laboratory analysis results on a regular basis.
- The municipality reserves the right to temporarily suspend or cancel the registration in case the activity of the entity poses a threat to public health, or if the work is not carried out in accordance with all the requirements, approved standards, & code of practices.

الشروط والأحكام:

- تتعهد الشركة بالالتزام بالقوانين والتشريعات والأدلة التالية:
 - القانون رقم (2) لسنة 2012م بشأن الحفاظ على المظهر العام والصحة والسكينة العامة في إمارة أبوظبي وتعديلاته ولوائحه التنفيذية.
 - القرار الإداري رقم (26) لسنة 2018 بشأن الصحة والسلامة العامة لخزانات مياه الشرب الخاصة بإمارة أبوظبي.
 - دليل أبو ظبي الإرشادي للرقابة الصحية على المباني والمرافق العامة.
 - قواعد الممارسة الخاصة بتفتيش وتنظيف خزانات مياه الشرب الخاصة بالمستهلكين.
- ضمان تسجيل كافة العاملين وحصولهم على شهادة المطابقة من مجلس أبوظبي للجودة والمطابقة وشهادة اللياقة الصحية من دائرة الصحة.
- إتباع كافة الإجراءات الفنية لمنع التلوث، والتقييد بخطة الطوارئ المعتمدة في حال حدوثه.
- الإحتفاظ بسجلات التشغيل المطلوبة بالإضافة إلى كافة نتائج التحليل المخبري بصورة مستمرة.
- تحتفظ البلدية بحقها في تعليق التسجيل مؤقتة أو إلغائه إذا كان عمل المنشأة يشكل خطراً على الصحة العامة، أو في حال عدم تنفيذ الأعمال وفقاً للإشتراطات والمعايير والأدلة المعتمدة.



بيان التسجيل
SCHEDULE OF CERTIFICATION
Ministry of Industry and Advanced Technology

Company Name:	Asia Detergents & Cleaning Ind LLC	اسم الشركة:	
Product Category:	Issue conformity certificate for non-regulated products	إصدار شهادات المطابقة للمنتجات غير الخاضعة للوائح الفنية	تصنيف المنتج:
Certificate No.:	25-02-00231/EN25-01-000457	رقم التسجيل:	
Registration Date:	03/02/2025	تاريخ التسجيل:	
Valid Until:	02/02/2026	صالح لغاية:	

Sr.No.	الاسم التجاري Brand Name	رقم الموديل Model Number	تفاصيل المنتج Product Details	الأبعاد/الحجم Dimension/Size	التقارير Reports	المواصفات المطبقة Applicable Standards	بلد المنشأ Country Of Origin
1	AQUA Kleene	6290614020332	WATER TANK CLEANER 3.785 Liters	3.785 Liters	0084 860419	UAE.S GSO 1948:2009	United Arab Emirates
2	AQUA Kleene	6290614010333	A/C DUCT CLEANING 3.785 Liters	3.785 Liters	0085 860420	UAE.S GSO 1948:2009	United Arab Emirates
Nothing Follows							



This is an electronic certificate and does not require stamp and signature. Certificate will be invalid in case of any modification

هذه الشهادة صدرت إلكترونياً ولا تحتاج لختم أو توقيع، أي كسب أو تغيير في هذه الشهادة يلغونها.



شهادة مطابقة CERTIFICATE OF CONFORMITY

Certificate Number:	25-02-00231/EN25-01-000457	رقم الشهادة:
Registration Date:	03/02/2025	تاريخ التسجيل:
Valid Until:	02/02/2026	صالحة لغاية:
Issued To:	Asia Detergents & Cleaning Ind LLC P.O. Box 855, Industrial Area # 3, Sharjah	اصدرت الى:
Sector:	Chemical	قطاع: كيمياء
Product Category:	Issue conformity certificate for non-regulated products	تصنيف المنتج: إصدار شهادات المطابقة للمنتجات غير الخاضعة للوائح الفنية
Product Sub-Category:	Voluntary Chemical	التصنيف الفرعي للمنتج:
Please check Schedule of certification for all product details		يرجى التحقق من بيان التسجيل المرفق لجميع تفاصيل المنتجات



Products are registered under the Emirates Conformity Assessment Scheme (ECAS) based on compliance to the Approved Standards



المنتجات مسجلة في نظام تقييم المطابقة الإماراتي (إيكاس) بناء على مطابقتها للمواصفات المعتمدة

This is an electronic certificate and does not require stamp and signature. Certificate will be invalid in case of any modification

هذه الشهادة صدرت إلكترونياً ولا تحتاج لختم أو توقيع، أي كشط أو تغيير في هذه الشهادة يلغونها.

WATER TANK / PIPE LINE CLEANING

SERVICE REPORT

S.No. 5637

Job Date : 25-12-2025 **SJO No** :
Customer : SHINING STAR SCHOOL **CSO No** :
Address : **Order Date** :
Location : SHABYA **Contact No** :

PROJECT LOCATION: ABODHBI	TANK TYPE <input type="checkbox"/> Domestic <input type="checkbox"/> Hot Water <input type="checkbox"/> Filtered Water <input type="checkbox"/> Others: <input type="checkbox"/> Septic Tank <input type="checkbox"/> Cold Water <input type="checkbox"/> Filtration
----------------------------------	---

TANK DETAILS									
Actual Size of Tank:	TANK 1			TANK 2			TANK 3		
	Liters USG Dimension Location			Liters USG Dimension Location			Liters USG Dimension Location		
	GROUND - 1500			GROUND - 1500			GROUND - 1500		
Water Level	<input type="checkbox"/> Full	<input checked="" type="checkbox"/> Half Full	<input type="checkbox"/> Empty	<input type="checkbox"/> Full	<input checked="" type="checkbox"/> Half Full	<input type="checkbox"/> Empty	<input type="checkbox"/> Full	<input checked="" type="checkbox"/> Half Full	<input type="checkbox"/> Empty
Condition of Tank Before Cleaning	<input type="checkbox"/> Clean	<input checked="" type="checkbox"/> Dirty	<input type="checkbox"/> Very Dirty	<input type="checkbox"/> Clean	<input checked="" type="checkbox"/> Dirty	<input type="checkbox"/> Very Dirty	<input type="checkbox"/> Clean	<input checked="" type="checkbox"/> Dirty	<input type="checkbox"/> Very Dirty
Lid/ Covers Fitted	<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input type="checkbox"/> Damaged	<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input type="checkbox"/> Damaged	<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input type="checkbox"/> Damaged
Bio Film	<input type="checkbox"/> YES	<input type="checkbox"/> NO		<input type="checkbox"/> YES	<input type="checkbox"/> NO		<input type="checkbox"/> YES	<input type="checkbox"/> NO	
Sediment	<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO		<input type="checkbox"/> YES	<input type="checkbox"/> NO		<input type="checkbox"/> YES	<input type="checkbox"/> NO	
Mould - Algae	<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO		<input type="checkbox"/> YES	<input type="checkbox"/> NO		<input type="checkbox"/> YES	<input type="checkbox"/> NO	
Stains	<input type="checkbox"/> YES	<input type="checkbox"/> NO		<input type="checkbox"/> YES	<input type="checkbox"/> NO		<input type="checkbox"/> YES	<input type="checkbox"/> NO	
Leaks	<input type="checkbox"/> YES	<input type="checkbox"/> NO		<input type="checkbox"/> YES	<input type="checkbox"/> NO		<input type="checkbox"/> YES	<input type="checkbox"/> NO	
Vent Screen Present	<input type="checkbox"/> YES	<input type="checkbox"/> NO	<input type="checkbox"/> NA	<input type="checkbox"/> YES	<input type="checkbox"/> NO	<input type="checkbox"/> NA	<input type="checkbox"/> YES	<input type="checkbox"/> NO	<input type="checkbox"/> NA
Vent Screen Installed by GB	<input type="checkbox"/> YES	<input type="checkbox"/> NO	<input type="checkbox"/> NA	<input type="checkbox"/> YES	<input type="checkbox"/> NO	<input type="checkbox"/> NA	<input type="checkbox"/> YES	<input type="checkbox"/> NO	<input type="checkbox"/> NA
Pipes	<input type="checkbox"/> Galvanized	<input type="checkbox"/> PVC	<input type="checkbox"/> Copper	<input type="checkbox"/> Galvanized	<input type="checkbox"/> PVC	<input type="checkbox"/> Copper	<input type="checkbox"/> Galvanized	<input type="checkbox"/> PVC	<input type="checkbox"/> Copper
Pipe Disinfection	<input type="checkbox"/> YES	<input type="checkbox"/> NO	<input type="checkbox"/> NA	<input type="checkbox"/> YES	<input type="checkbox"/> NO	<input type="checkbox"/> NA	<input type="checkbox"/> YES	<input type="checkbox"/> NO	<input type="checkbox"/> NA
Pumps Working Order	<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO		<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO		<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	
Valves Working	<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO		<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO		<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	
Tank Fitted with Drain	<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO		<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO		<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	
Ladder Inside	<input type="checkbox"/> YES	<input type="checkbox"/> NO		<input type="checkbox"/> YES	<input type="checkbox"/> NO		<input type="checkbox"/> YES	<input type="checkbox"/> NO	
Ladder Outside	<input type="checkbox"/> YES	<input type="checkbox"/> NO		<input type="checkbox"/> YES	<input type="checkbox"/> NO		<input type="checkbox"/> YES	<input type="checkbox"/> NO	
Concrete	<input type="checkbox"/> Coated	<input type="checkbox"/> Uncoated		<input type="checkbox"/> Coated	<input type="checkbox"/> Uncoated		<input type="checkbox"/> Coated	<input type="checkbox"/> Uncoated	
Fiber Glass	<input type="checkbox"/> Molded	<input type="checkbox"/> Unmolded		<input type="checkbox"/> Molded	<input type="checkbox"/> Unmolded		<input type="checkbox"/> Molded	<input type="checkbox"/> Unmolded	
Panel	<input type="checkbox"/> G R P	<input type="checkbox"/> Steel GI		<input type="checkbox"/> G R P	<input type="checkbox"/> Steel GI		<input type="checkbox"/> G R P	<input type="checkbox"/> Steel GI	
Material	<input type="checkbox"/> Polyurethane	<input checked="" type="checkbox"/> PVC		<input type="checkbox"/> Polyurethane	<input checked="" type="checkbox"/> PVC		<input type="checkbox"/> PVC	<input checked="" type="checkbox"/> PVC	

MATERIALS & CONSUMABLES USED											
<input checked="" type="checkbox"/> Aqua Kleen	<input type="checkbox"/> Hydrochloric Acid	<input checked="" type="checkbox"/> Submersible Pump	<input type="checkbox"/> Tanker	<input type="checkbox"/> Chlorine	<input type="checkbox"/> Cotton Rug	<input checked="" type="checkbox"/> Exhaust Fan	<input type="checkbox"/> Jetting Machine	<input type="checkbox"/> EGC 2602	<input checked="" type="checkbox"/> Hand Gloves	<input checked="" type="checkbox"/> LED Light	<input checked="" type="checkbox"/> Gas Meter
<input type="checkbox"/> EGC 2705	<input type="checkbox"/> Teflon Tape	<input type="checkbox"/> Pressure Washer	<input checked="" type="checkbox"/> PPE								

LAST CLEANING DATE : 25-12-2025 **NEXT CLEANING DATE** : 25-06-2026

Clients Feedback:

GBFM Supervisor Print Name: IAHIL RAZA	Signature & Date: 	Time Start:
Site Representative Print Name: Sajon	Signature & Date: 	Time Finish:



WATER TANK / PIPE LINE CLEANING

SERVICE REPORT

S.No. 5638

Job Date : 25-12-2025
Customer : SHINING STAR SCHOOL
Address :
Location : SHABYA
SJO No :
CSO No :
Order Date :
Contact No :

PROJECT LOCATION: ABU DHABI
TANK TYPE: Domestic, Hot Water, Filtered Water, Others, Septic Tank, Cold Water, Filtration

TANK DETAILS table with columns for TANK 1, TANK 2, and TANK 3. Includes rows for Actual Size of Tank, Water Level, Condition of Tank Before Cleaning, Lid/Covers Fitted, Bio Film, Sediment, Mould - Algae, Stains, Leaks, Vent Screen Present, Vent Screen Installed by GB, Pipes, Pipe Disinfection, Pumps Working Order, Valves Working, Tank Fitted with Drain, Ladder Inside, Ladder Outside, Concrete, Fiber Glass, Panel, and Material.

MATERIALS & CONSUMABLES USED table listing items like Aqua Kleen, Chlorine, EGC 2602, EGC 2705, Hydrochloric Acid, Cotton Rug, Hand Gloves, Teflon Tape, Submersible Pump, Exhaust Fan, LED Light, Pressure Washer, Tanker, Jetting Machine, Gas Meter, and PPE.

LAST CLEANING DATE: 25-12-2025
NEXT CLEANING DATE: 25-06-2026

Clients Feedback:

GBFM Supervisor Print Name: Ali Raza
Signature & Date:
Time Start:
Site Representative Print Name: Fajan
Site Representative Cellphone No:
Signature & Date:
Time Finish:



WATER TANK / PIPE LINE CLEANING

SERVICE REPORT

S.No. 5639

Job Date : 26-12-2025
Customer : SHINING STAR SCHOOL
Address :
Location : SHABIYA
SJO No :
CSO No :
Order Date :
Contact No :

PROJECT LOCATION: ABU DHABI
TANK TYPE: Domestic, Hot Water, Filtered Water, Others, Septic Tank, Cold Water, Filtration

TANK DETAILS

Table with columns for TANK 1, TANK 2, and TANK 3. Rows include Actual Size of Tank, Water Level, Condition of Tank Before Cleaning, Lid/Covers Fitted, Bio Film, Sediment, Mould - Algae, Stains, Leaks, Vent Screen Present, Vent Screen Installed by GB, Pipes, Pipe Disinfection, Pumps Working Order, Valves Working, Tank Fitted with Drain, Ladder Inside, Ladder Outside, Concrete, Fiber Glass, Panel, and Material.


MATERIALS & CONSUMABLES USED

Form listing materials and consumables used, including Aqua Kleen, Chlorine, EGC 2602, EGC 2705, Hydrochloric Acid, Cotton Rug, Hand Gloves, Teflon Tape, Submersible Pump, Exhaust Fan, LED Light, Pressure Washer, Tanker, Jetting Machine, Gas Meter, and PPE.

LAST CLEANING DATE: 26-12-2025
NEXT CLEANING DATE: 26-06-2026

Clients Feedback:

GBFM Supervisor Print Name: RAZA, Signature & Date, Time Start
Site Representative Print Name: Sajon, Site Representative Cellphone No, Signature & Date, Time Finish

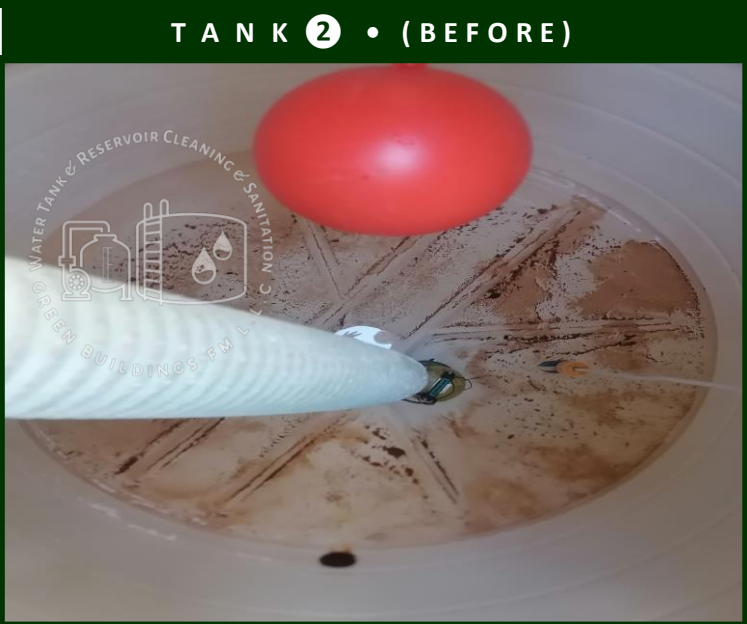

TANK 1 • (STICKER)

GREEN BUILDINGS FACILITY MANAGEMENT L.L.C
For Inquiries: 02 550 6361 | 052 187 7554
hello@gbfm.ae | www.gbfm.ae

TANK NO.: **SHINING STAR SCHOOL** TANK NO.: **# 1**

TANK LOCATION: **GROUND**

TANK TYPE: RCC GRP PVC FRP GI GS

TANK SIZE: **25-12-2025**

CLEANING DATE:		JAN	FEB	MAR	APR	MAY	JUN	JUL	AUG	SEP	OCT	NOV	DEC
2025	<input checked="" type="checkbox"/>	01	02	03	04	05	06	07	08	09	10	11	12
2026		11	12	13	14	15	16	17	18	19	20	21	22
2027		21	22	23	24	<input checked="" type="checkbox"/> 25	26	27	28	29	30		
2028		31											

NEXT CLEANING DATE: **25-06-2026** Annually (6) Month Others Water Sample

Inspected & Cleaned by: **VAIRAZA**

TANK 2 • (STICKER)

GREEN BUILDINGS FACILITY MANAGEMENT L.L.C
For Inquiries: 02 550 6361 | 052 187 7554
hello@gbfm.ae | www.gbfm.ae

TANK NO.: **SHINING STAR SCHOOL** TANK NO.: **# 2**

TANK LOCATION: **GROUND**

TANK TYPE: RCC GRP PVC FRP GI GS

TANK SIZE: **25-12-2025**

CLEANING DATE:		JAN	FEB	MAR	APR	MAY	JUN	JUL	AUG	SEP	OCT	NOV	DEC
2025	<input checked="" type="checkbox"/>	01	02	03	04	05	06	07	08	09	10	11	12
2026		11	12	13	14	15	16	17	18	19	20	21	22
2027		21	22	23	24	<input checked="" type="checkbox"/> 25	26	27	28	29	30		
2028		31											

NEXT CLEANING DATE: **25-06-2026** Annually (6) Month Others Water Sample

Inspected & Cleaned by: **VAIRAZA**

TANK 3 • (BEFORE)



TANK 4 • (BEFORE)



TANK 3 • (AFTER)



TANK 4 • (AFTER)



TANK 3 • (STICKER)

GREEN BUILDINGS FACILITY MANAGEMENT L.L.C
 For Inquiries: 02 550 6361 | 052 187 7554
 hello@gbfm.ae | www.gbfm.ae

TANK NO.: SHINING STAR SCHOOL
GROUND TANK NO.: # 3

TANK TYPE: RCC GRP PVC FRP GI GS

CLEANING DATE: 25-12-2025

CLEANING DATE:	JAN	FEB	MAR	APR	MAY	JUN	JUL	AUG	SEP	OCT	NOV	DEC
2025	✓01	02	03	04	05	06	07	08	09	10	11	12
2026	11	12	13	14	15	16	17	18	19	20	21	22
2027	23	24	25	26	27	28	29	30	31			

NEXT CLEANING DATE: 25-06-2026 Annually (6) Month Others

Inspected & Cleaned by: LAIRAZA

TANK 4 • (STICKER)

GREEN BUILDINGS FACILITY MANAGEMENT L.L.C
 For Inquiries: 02 550 6361 | 052 187 7554
 hello@gbfm.ae | www.gbfm.ae

TANK NO.: SHINING STAR SCHOOL
GROUND TANK NO.: # 4

TANK TYPE: RCC GRP PVC FRP GI GS

CLEANING DATE: 25-12-2025

CLEANING DATE:	JAN	FEB	MAR	APR	MAY	JUN	JUL	AUG	SEP	OCT	NOV	DEC
2025	✓01	02	03	04	05	06	07	08	09	10	11	12
2026	11	12	13	14	15	16	17	18	19	20	21	22
2027	23	24	25	26	27	28	29	30	31			

NEXT CLEANING DATE: 25-06-2026 Annually (6) Month Others

Inspected & Cleaned by: LAIRAZA

TANK 5 • (BEFORE)



TANK 6 • (BEFORE)



TANK 5 • (AFTER)



TANK 6 • (AFTER)



TANK 5 • (STICKER)

GREEN BUILDINGS FACILITY MANAGEMENT L.L.C
For Inquiries: (02) 550 6361 | 052 187 7554
info@gbfm.ae | www.gbfm.ae

TANK NO.: **#5**

TANK LOCATION: **SHINING STAR SCHOOL ROOF**

<input checked="" type="checkbox"/> RCCV	<input type="checkbox"/> GRP	<input type="checkbox"/> PVC	<input type="checkbox"/> FRP	<input type="checkbox"/> GI	<input type="checkbox"/> GS
--	------------------------------	------------------------------	------------------------------	-----------------------------	-----------------------------

TANK SIZE: _____

CLEANING DATE: **25-12-2025**

JAN	FEB	MAR	APR	MAY	JUN	JUL	AUG	SEP	OCT	NOV	DEC
2025	01	02	03	04	05	06	07	08	09	10	
2026	11	12	13	14	15	16	17	18	19	20	
2027	21	22	23	24	25	26	27	28	29	30	
2028	31										

NEXT CLEANING DATE: **25-12-2026** Annually Every Month Others

Inspected & Cleaned by: **AIRAZA**

TANK 6 • (STICKER)

GREEN BUILDINGS FACILITY MANAGEMENT L.L.C
For Inquiries: (02) 550 6361 | 052 187 7554
info@gbfm.ae | www.gbfm.ae

TANK NO.: **#6**

TANK LOCATION: **SHINING STAR SCHOOL ROOF**

<input checked="" type="checkbox"/> RCCV	<input type="checkbox"/> GRP	<input type="checkbox"/> PVC	<input type="checkbox"/> FRP	<input type="checkbox"/> GI	<input type="checkbox"/> GS
--	------------------------------	------------------------------	------------------------------	-----------------------------	-----------------------------

TANK SIZE: _____

CLEANING DATE: **25-12-2025**

JAN	FEB	MAR	APR	MAY	JUN	JUL	AUG	SEP	OCT	NOV	DEC
2025	01	02	03	04	05	06	07	08	09	10	
2026	11	12	13	14	15	16	17	18	19	20	
2027	21	22	23	24	25	26	27	28	29	30	
2028	31										

NEXT CLEANING DATE: **25-12-2026** Annually Every Month Others

Inspected & Cleaned by: **AIRAZA**

SERVICES OFFERED

- HVAC MAINTENANCE & DUCT CLEANING
- MEP
- PEST CONTROL
- WATER TANK & RESERVOIR CLEANING & DISINFECTION
- DISINFECTION & STERILIZATION
- KITCHEN HOOD CLEANING
- GREASE TRAP CLEANING
- MARBLE & CARPET CLEANING
- CARPENTRY WORKS
- LANDSCAPING
- GENERAL CLEANING



Thank You!


Your trust in GBFM is greatly appreciated, and we are committed to provide you with the highest quality services. If you have any questions or need any assistance, please do not hesitate to reach out to us at hello@gbfm.ae.


Let us Know your feedback at clientsupport@gbfm.ae.

Once again, thank you for choosing GBFM. We are excited to serve you and look forward to achieve great results together.

Best regards,



 Office No. 2101, 21st Floor C88 Tower A,
DNATA Bldg., Abu Dhabi, UAE

 Telephone
02 5506361

 Website
www.gbfm.ae